

NOTES:

1. This proprietary balustrade system complies with New Zealand Building Code Clause B1 Structure, B1/AS1 Amendment 15, B1/VM1, F2 Hazardous Building Materials and F4 Safety From Falling Third Edition, subject to:

- all products meeting the required performance specification
- site installation carried out in accordance with the intent of this drawing

2. Based on barrier loads from AS/NZS 1170.1 and extra high wind zone (2.13 kPa) or less, maximum height H above floor level and safety glass options are:

For commercial occupancies B, E & C3 of Table 3.3 AS/NZS 1170.1

Maximum height H 1100mm

Safety glass options according to 22.4.3 and Table 14 of NZS 4223.3:2016 are:

- a. Viridian 12mm toughened glass with interlinking rail at 1100mm above FFL
- b. Viridian 13.2 mm EVA toughened laminated glass with interlinking gap clamps, and a maximum glass pane width of 2000mm
- c. Viridian 13.52mm toughened SentryGlas laminated glass with minimum pane width of 1000mm

Maximum height H 1300mm

Safety glass options according to 22.4.3 and Table 14 of NZS 4223.3:2016 are:

- a. Viridian 15mm toughened glass with interlinking rail at 1100 mm above FFL
- b. Viridian 17.2mm EVA toughened laminated glass with interlinking gap clamps and maximum glass pane width of 2000mm
- c. Viridian 17.52mm SentryGlas toughened laminated glass with minimum pane width of 1000mm

-Interlinking rail or gap clamps must to connected to each glass pane, structural post, or building element as required by NZS 4223.3:2016


-Gap clamps shall be fixed on top of the glass panel.


3. Concrete and steel design is the responsibility of others.

4. A handrail of 32-50mm diameter is required for stairs and ramps exceeding 1:20 slope. Fit handrail between 900mm and 1000mm above the pitchline. Refer NZBC D1/AS1.


5. The distance between the base fixing and the end of the channel or a joint must not exceed 200mm.

DO NOT INSTALL THIS BALUSTRADE SYSTEM OVER WATERPROOFING MEMBRANE

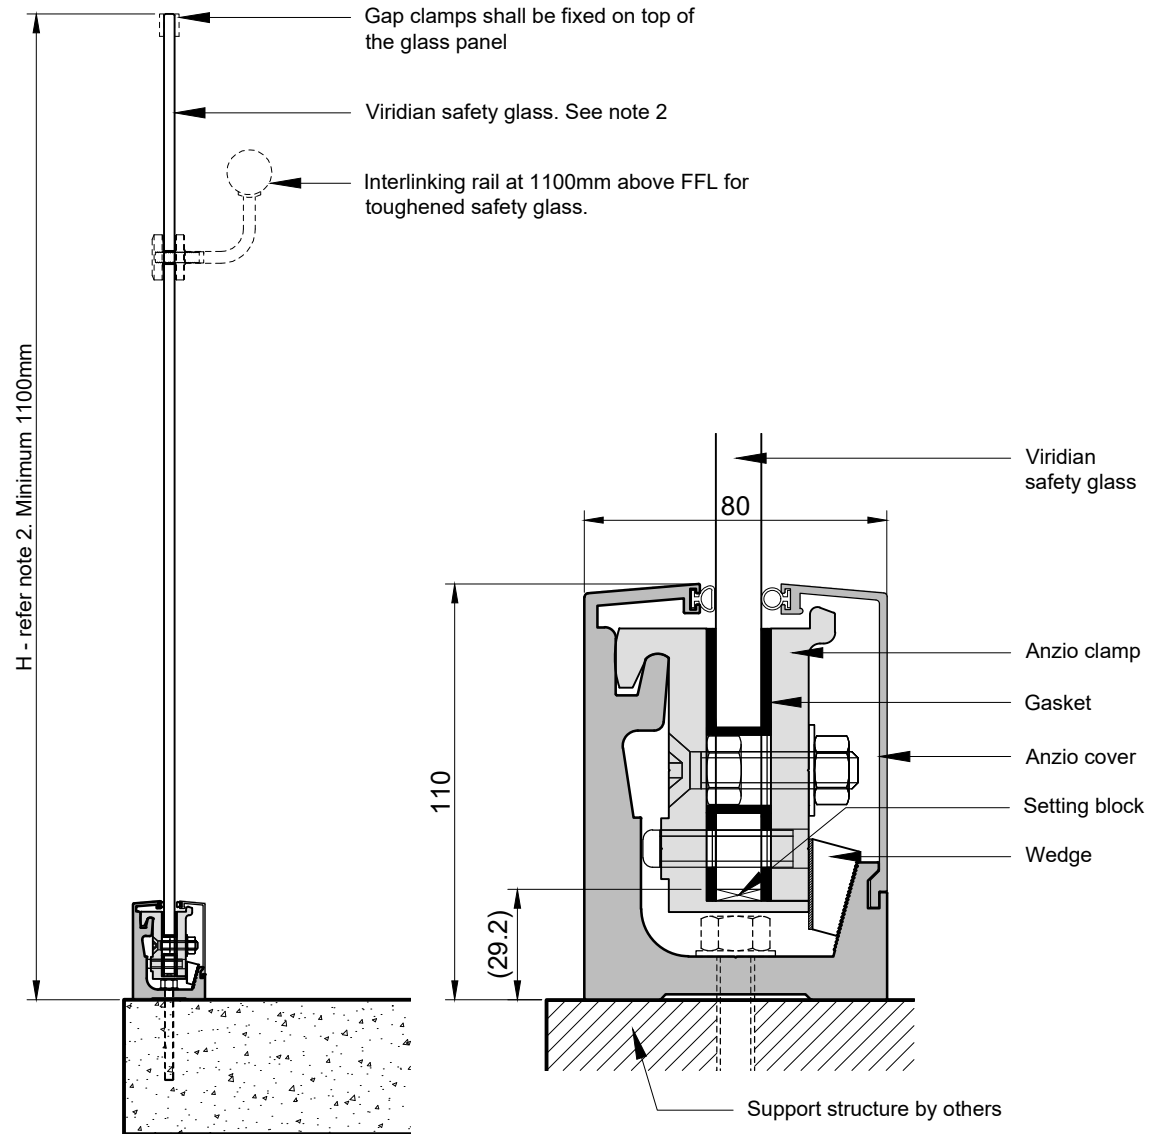


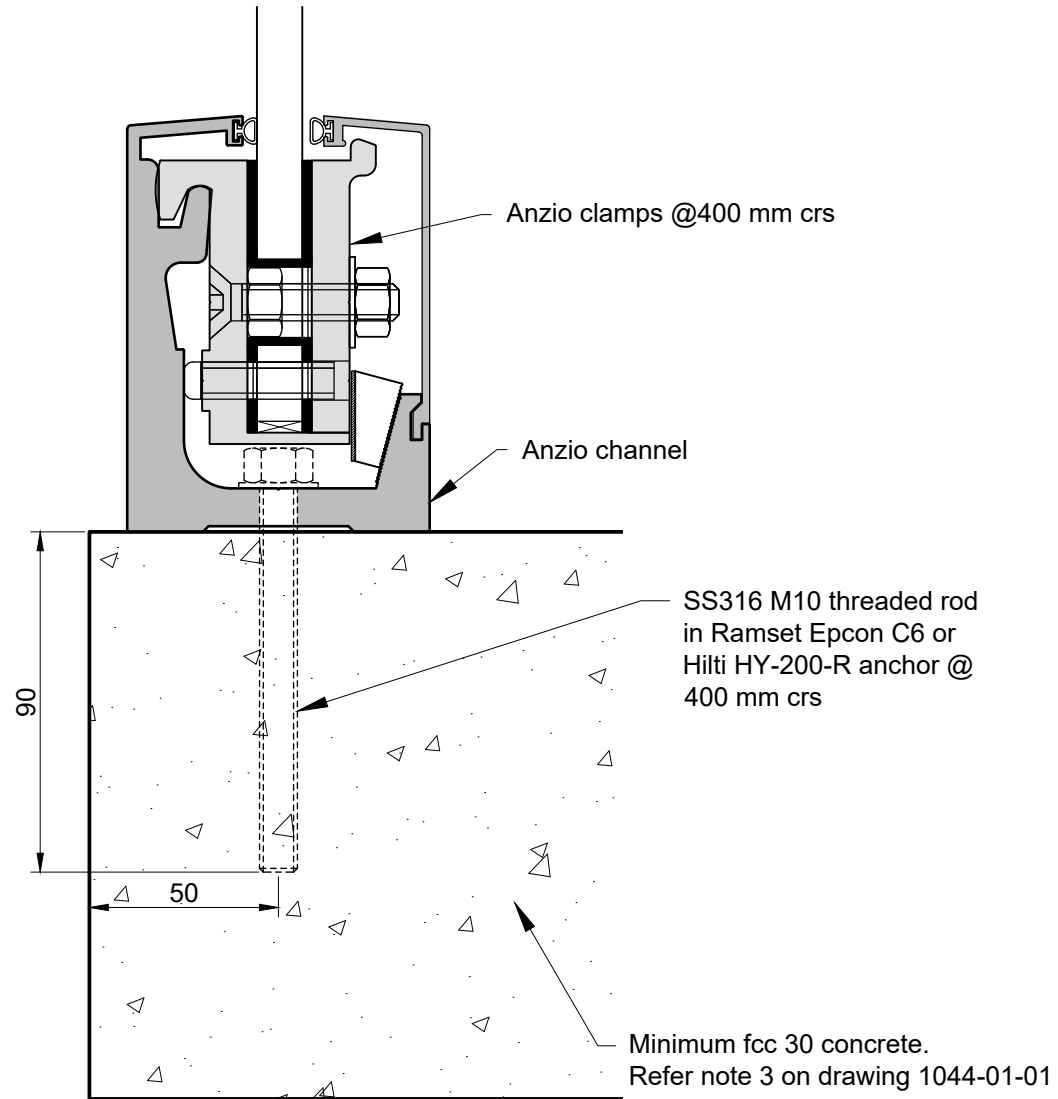

FIXING DETAIL A - CONCRETE

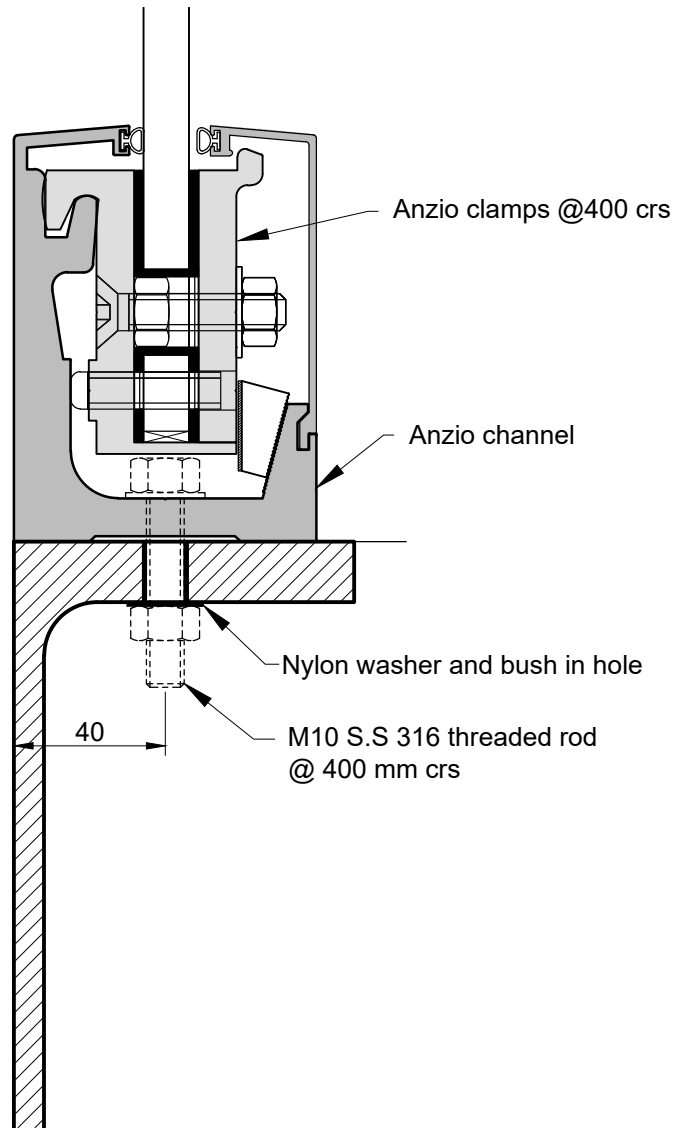

FIXING DETAIL A

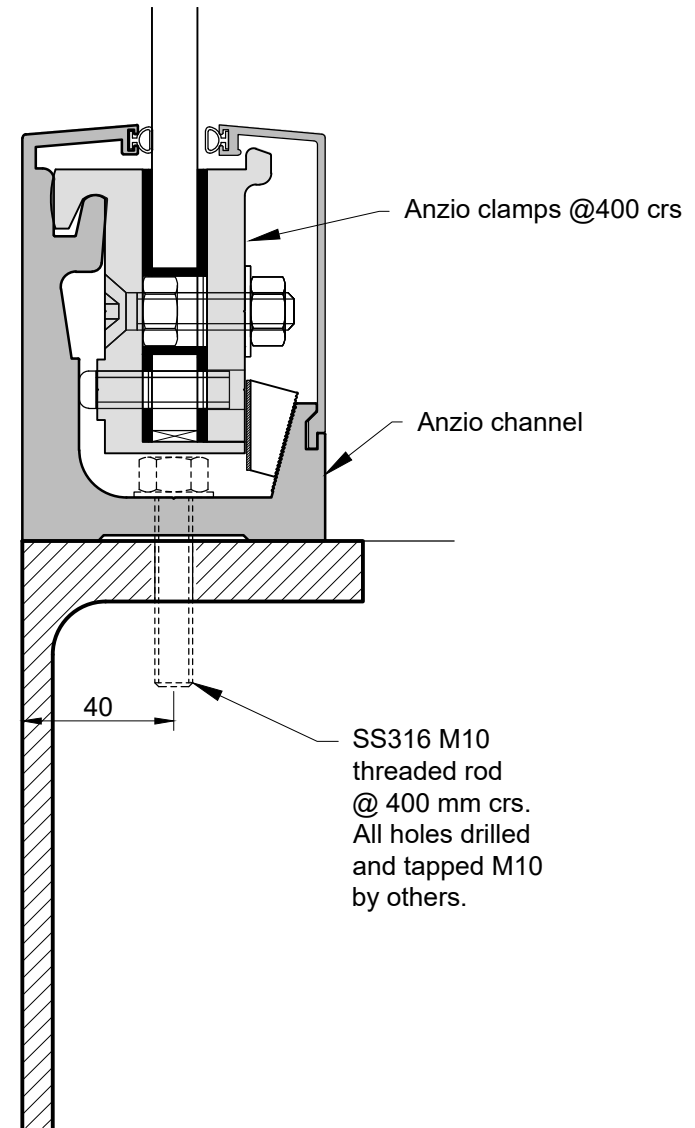

FIXING DETAIL B
FOR INTERNAL INSTALLATION ONLY